


UTILITIES (DESIGNED BY OTHERS)

ANY DISTURBANCE OF THE SOILS OUTSIDE THE 1:1 EXCAVATION AREA MUST ALSO BE FILLED WITH SELECT FILL

THIS AREA MUST BE BACKFILLED WITH SELECT FILL, COMPACTED TO 100 PERCENT OF THE STANDARD PROCTOR MAXIMUM DRY DENSITY.

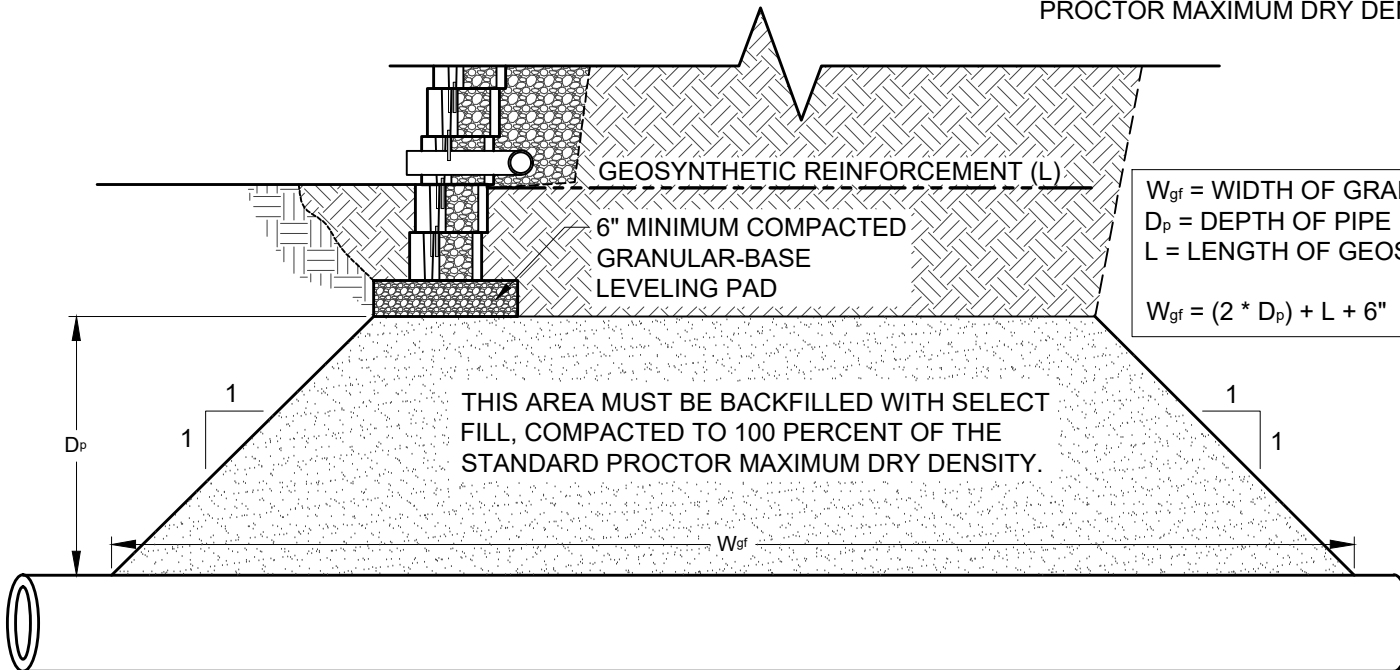

GEOSYNTHETIC REINFORCEMENT (L)

6" MINIMUM COMPACTED GRANULAR-BASE LEVELING PAD

W_{gf} = WIDTH OF GRANULAR FILL
 D_p = DEPTH OF PIPE
 L = LENGTH OF GEOSYNTHETIC REINFORCEMENT
 $W_{gf} = (2 * D_p) + L + 6"$

THIS AREA MUST BE BACKFILLED WITH SELECT FILL, COMPACTED TO 100 PERCENT OF THE STANDARD PROCTOR MAXIMUM DRY DENSITY.



This drawing is for illustrative purposes only and should not be used for construction without the signature of a registered professional engineer.

www.anchordiamond.com

© 2022 ANCHOR Engineering, LLC® and © 2022 ANCHOR DIAMOND®

Diamond Pro® PS Retaining Wall System

Typical Utilities Below Wall

Scale:	Drawn by:
3/8" = 1'-0"	SB
Date:	Drawing number:
10/7/2022	DPSS20